

**GSP MAXI-POWERPACK  
(GSP 140 V)  
discontinued !**

## Stepper Motor Power Pack with Axis Controller

### GSP Stepper Motor Power Pack

The GSP power pack is an 'intelligent' drive for two-phase stepper motors. The GSP vario power pack is designed for stepper motors up to 9 A<sub>PEAK</sub> (70 V motor voltage). The GSP maxi power pack is used for larger stepper motors up to 17 A<sub>PEAK</sub> (140 V motor voltage).

Motor currents can be set individually in 16 stages.

The GSP is controlled by a micro controller which receives the control commands from a superior controller, e. g. from a PC or a PLC. So it is possible to operate in two operation modes: online or PLC mode. The drive is connected to the superior controller via RS 232 or RS 485 (4-wire) serial interface.

### Axis Controller

The GSP power packs operate with a dynamic ministep / full step changeover.

The step resolution is automatically adapted to the frequency:


1/8 → 1/4 → 1/2 → full step → 1/2 → 1/4 → 1/8.

Ministep guarantees high resonance suppression during a slow run. Full step enables the complete motor power at high frequencies.

The GSP use phytron's welltried technology, now with enhanced field synchronized current chopped regulation based on the patented SYNCHROCHOP principle developed by phytron.



### Overview / Dimensions

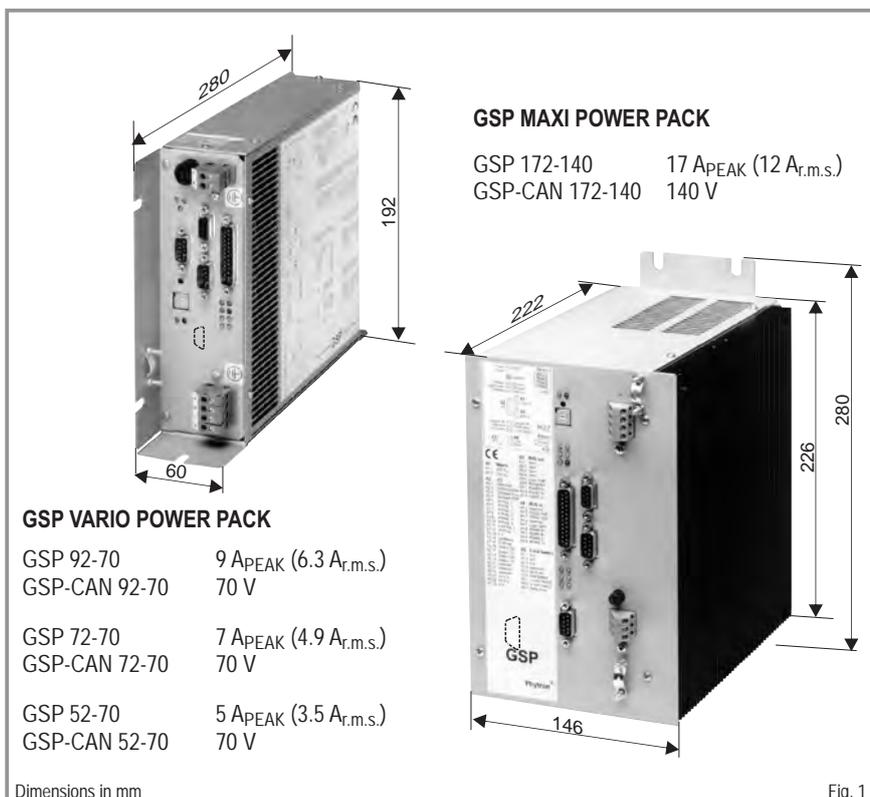

### Technical Information

- A compact stepper motor module for bipolar control of two-phase stepper motors
- Power supply unit for 230 V<sub>AC</sub> (Optional 115 V<sub>AC</sub>: Vario Power Pack)
- LED display of the working condition
- PLC mode or online mode
- Parametrization and configuration in the online mode with IPCOMM
- 12 Digital inputs, 6 digital outputs, opto-decoupled
- Input logic 24 V
- Phase currents adjustable in 16 stages
- Step resolution up to 1/8 step
- Easy to install design
- Mounting bracket for wall mounting
- Fully EMC compliant metal housing
- Line filter for power supply
- Optional: SFI module for indication of step failures

## Operator's Controls

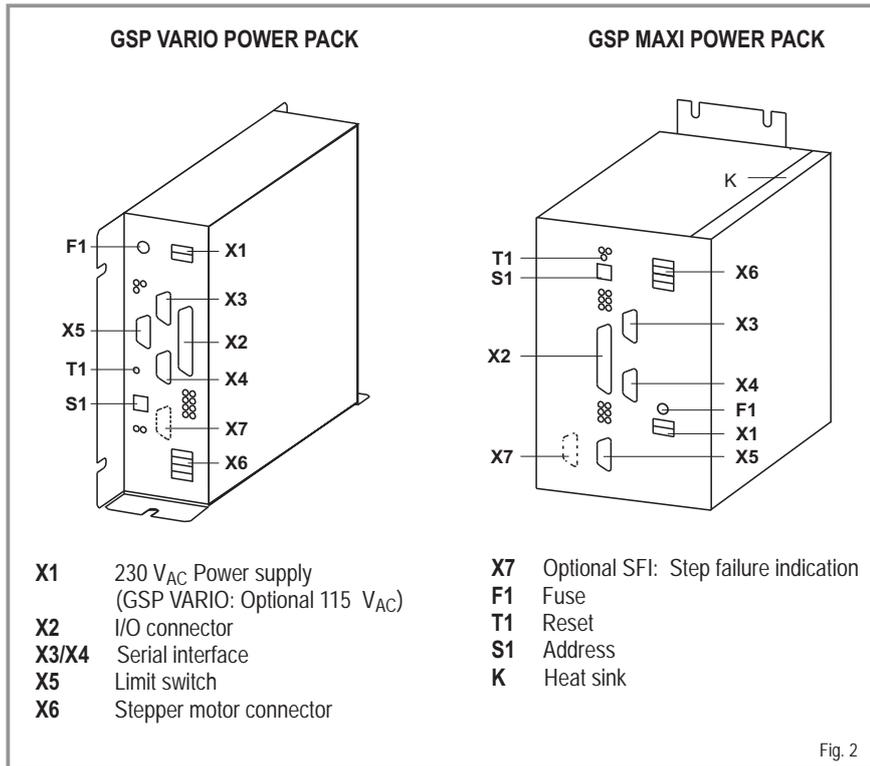


Fig. 2


## Digital Inputs and Outputs

The 12 digital inputs are optically isolated from the GSP supply voltage (X2 connector).

This assures best noise suppression between control and power circuit.

The nominal input level is 24 V.

Input Logic

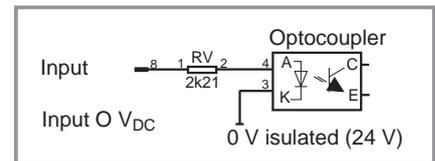

The 6 digital outputs are optically isolated and the rated output current is 50 mA.

## Input Limit Switches

Two limit switches type NCC can be connected to the X5 connector.

The 24 V<sub>DC</sub> auxiliary voltage for the limit switches and the outputs has to be supplied to the X2 connector.

It is also possible to connect mechanical limit switches type NCC.

## EMC Compliant Connection of the Stepper Motors

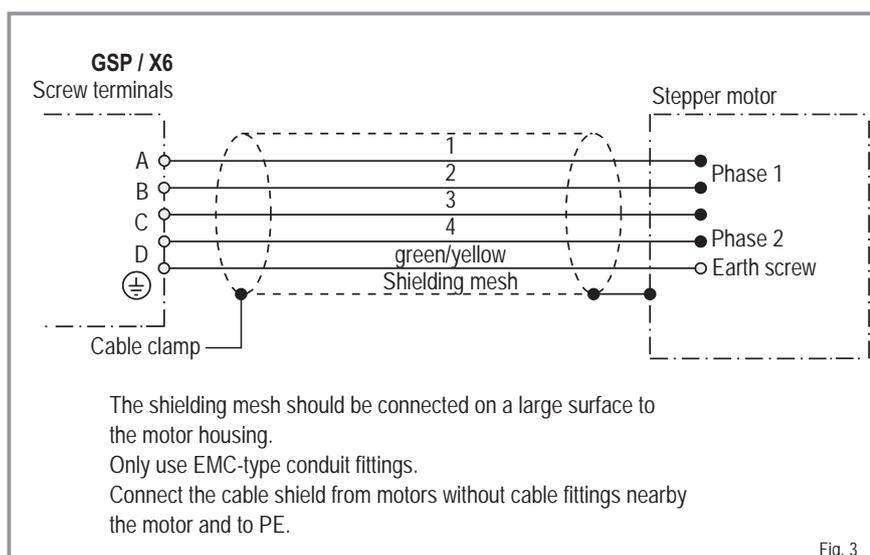


Fig. 3

## Stepper Motor

The phytron stepper motors ZSS, ZSH, RSS, RSH or other two-phase stepper motors can be connected in 4 or 8 lead wiring.


It is also possible to connect 6 lead stepper motors dependent on the design.

The winding inductivity of a motor phase should not be less than 0.5 mH.


The winding resistance should be less than 10 Ohm.

## Complex Handling Operation / PLC Mode

### GSP and GSP-CAN for Complex Handling Operation

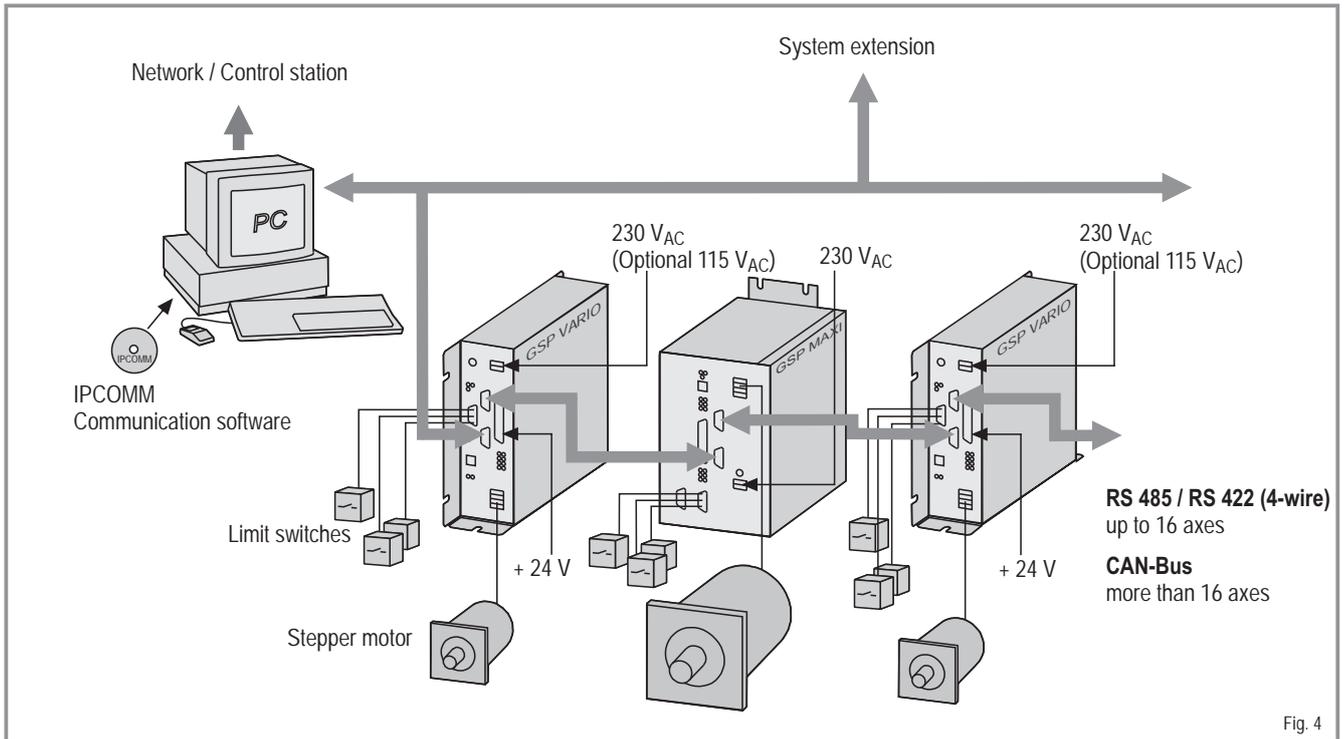

### GSP in the PLC Mode

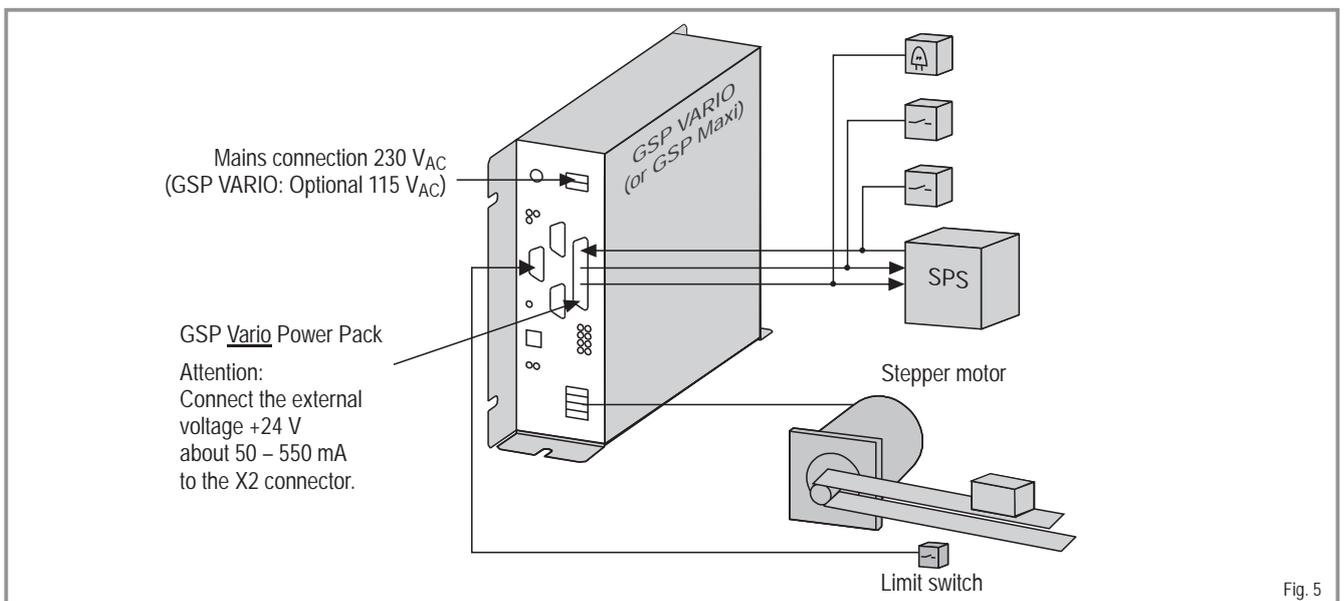

**IPCOMM Communication Software**

IPCOMM, a Windows® software for configuring and programming, is included by each GSP. IPCOMM is used to set up parameters and to program the PLC sequences for the GSP.

The instructions can be integrated optionally into the own programs as ASCII strings - e. g. with LabView, Hyper Terminal or C. So it is possible to transmit the parameters to each GSP during initializing or changing a module and evaluate the status signal.

**IPCOMM Characteristics**

- Desktop with pull-down menus and mouse support, hotkey functions
- Configuration of the GSP
- Definition and transfer of PLC instructions
- Relative or absolute motion instructions
- Parameter settings like speed, ramp, motor current

**Option: SFI Module**

A stepper motor with encoder can be permanently monitored by the optional SFI module (Step Failure Indication). So faulty motor positioning in case of overload can be rapidly detected.

The SFI circuit compares the set value (arriving pulse signals) with the true value (stepper motor position). The signal variation must not exceed seven full steps, otherwise an error signal is generated. The GSP will react on the error signal and stop the motor.

The incremental encoder supply voltage is generated by the SFI module: approx. 5 V / maximum 100 mA.

Suitable incremental encoder resolutions: 50 / 200 / 500 / 1000.

A differential encoder with two output signals shifted by 90° can be wired to the X7 connector.

The SFI module's signal inputs are optically insulated. High noise immunity is obtained when driving the signal inputs with RS 422 control signals.

**IPCOMM Menu Example**

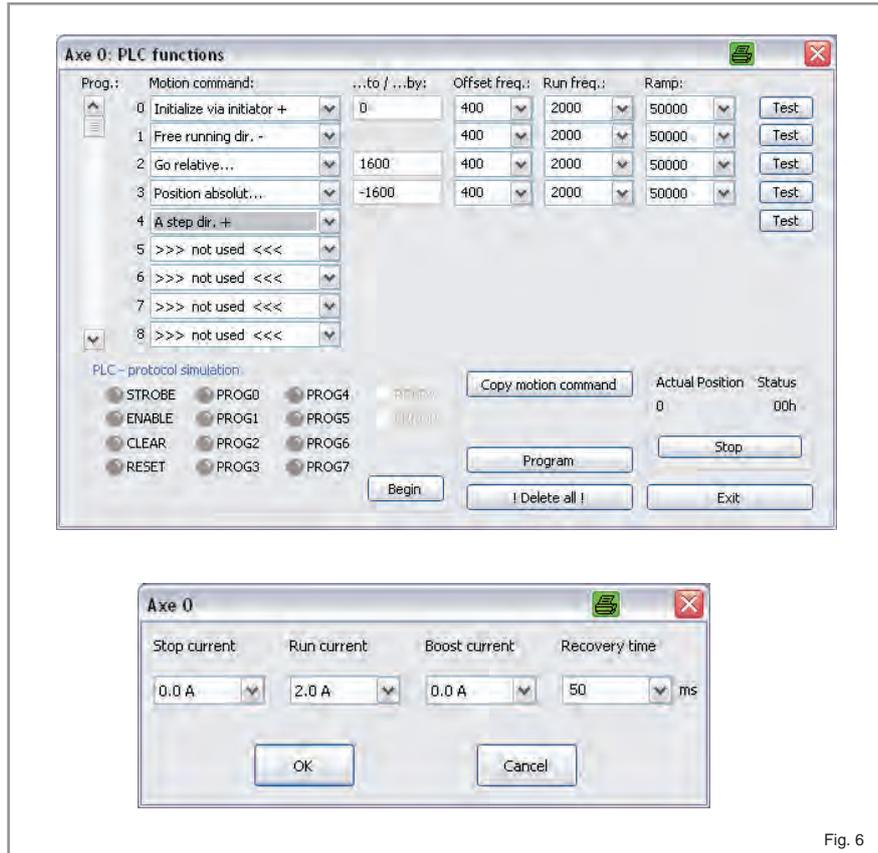


Fig. 6

**Ordering Code**

	GSP	92	-	70	-	SFI	-	CAN	-	230
Type	GSP = Stepper motor drive									
Peak current	9	= 9 A								
	17	= 17 A								
Current regulation	2 = SYNCHROCHOP									
Motor voltage	70	= 70 V								
	140	= 140 V								
Optional	SFI = Step Failure Indication									
Interface	RS232 = RS 232 / RS 485									
	CAN = CAN-Bus									
Power supply	230 = 230 V Standard									
	115 = 115 V Optional for Vario									